




## Labeling for Fire Equipment Mounted on Columns (Typical)

[CFC 906.6 and NFPA 14 6.3.8.5.]

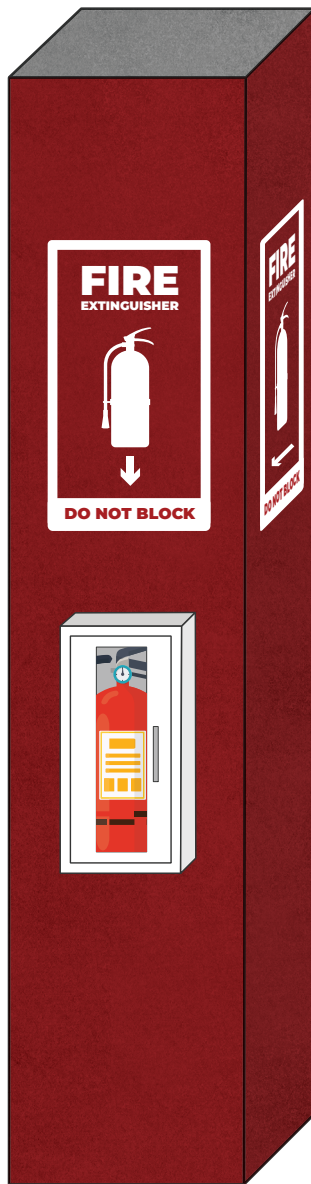

Bottom of Column

- 1 The entire column shall be painted red on all sides in a manner that contrasts from other columns.
- 2 The type of system (standpipe or fire extinguisher) shall be labeled on all sides in a contrasting color. Labeling shall not be obstructed.
- 3 Equipment may be mounted between three (3) and five (5) feet from the floor.

Note: Deviations from this detail are allowed if the intent of having fire equipment readily discernible is maintained.