

**Appendix D**  
**Noise Assessment**

*This Page Intentionally Left Blank*

***BAY AREA SELF STORAGE – KING ROAD  
NOISE AND VIBRATION ASSESSMENT  
2905 SOUTH KING ROAD  
SAN JOSÉ, CALIFORNIA***

**January 27, 2017**



**Prepared for:**

**Leianne Humble  
Senior Planner  
Denise Duffy & Associates, Inc.  
947 Cass St. Suite 5  
Monterey, CA 93940**

**Prepared by:**

**Casey Zaglin and  
Michael S. Thill**

***ILLINGWORTH & RODKIN, INC.***

***//// Acoustics • Air Quality ////***

**1 Willowbrook Court, Suite 120  
Petaluma, CA 94954  
(707) 794-0400**

**Job No.: 16-181**

## INTRODUCTION

The Bay Area Self Storage-King Road project proposes to demolish the existing one-story office building and radio towers and a rezoning of the 9.9 acre site at 2905 South King Road in the City of San José from a PD (Planned Development) to LI (Light Industrial) designation. The rezoning would allow ministorage (self-storage) uses on the western and northern portions of the site and approximately 65,000 square feet of undetermined light industrial uses on the southeast portion of the site. Access to the site would be provided via South King Road.

This report evaluates the project's potential to result in significant impacts with respect to applicable California Environmental Quality Act (CEQA) guidelines. The report is divided into three sections: 1) the Setting Section provides a brief description of the fundamentals of environmental noise, summarizes applicable regulatory criteria, and discusses the results of the ambient noise monitoring survey completed to document existing noise conditions; 2) the General Plan Consistency section discusses land use compatibility utilizing noise and vibration-related policies in the City's General Plan; and, 3) the Impacts and Mitigation Measures Section describes the significance criteria used to evaluate project impacts, provides a discussion of each project impact, and presents mitigation measures, where necessary, to provide a compatible project in relation to adjacent noise sources and land uses.

## SETTING

### Fundamentals of Environmental Noise

Noise may be defined as unwanted sound. Noise is usually objectionable because it is disturbing or annoying. The objectionable nature of sound could be caused by its *pitch* or its *loudness*. *Pitch* is the height or depth of a tone or sound, depending on the relative rapidity (*frequency*) of the vibrations by which it is produced. Higher pitched signals sound louder to humans than sounds with a lower pitch. *Loudness* is intensity of sound waves combined with the reception characteristics of the ear. Intensity may be compared with the height of an ocean wave in that it is a measure of the amplitude of the sound wave.

In addition to the concepts of pitch and loudness, there are several noise measurement scales which are used to describe noise in a particular location. A *decibel (dB)* is a unit of measurement which indicates the relative amplitude of a sound. The zero on the decibel scale is based on the lowest sound level that the healthy, unimpaired human ear can detect. Sound levels in decibels are calculated on a logarithmic basis. An increase of 10 decibels represents a ten-fold increase in acoustic energy, while 20 decibels is 100 times more intense, 30 decibels is 1,000 times more intense, etc. There is a relationship between the subjective noisiness or loudness of a sound and its intensity. Each 10 decibel increase in sound level is perceived as approximately a doubling of loudness over a fairly wide range of intensities. Technical terms are defined in Table 1.

There are several methods of characterizing sound. The most common in California is the *A-weighted sound level (dBA)*. This scale gives greater weight to the frequencies of sound to which the human ear is most sensitive. Representative outdoor and indoor noise levels in units of dBA are shown in Table 2. Because sound levels can vary markedly over a short period of time, a

method for describing either the average character of the sound or the statistical behavior of the variations must be utilized. Most commonly, environmental sounds are described in terms of an average level that has the same acoustical energy as the summation of all the time-varying events. This *energy-equivalent sound/noise descriptor* is called  $L_{eq}$ . The most common averaging period is hourly, but  $L_{eq}$  can describe any series of noise events of arbitrary duration.

The scientific instrument used to measure noise is the sound level meter. Sound level meters can accurately measure environmental noise levels to within about plus or minus 1 dBA. Various computer models are used to predict environmental noise levels from sources, such as roadways and airports. The accuracy of the predicted models depends upon the distance the receptor is from the noise source. Close to the noise source, the models are accurate to within about plus or minus 1 to 2 dBA.

Since the sensitivity to noise increases during the evening and at night -- because excessive noise interferes with the ability to sleep -- 24-hour descriptors have been developed that incorporate artificial noise penalties added to quiet-time noise events. The *Community Noise Equivalent Level (CNEL)* is a measure of the cumulative noise exposure in a community, with a 5 dB penalty added to evening (7:00 pm - 10:00 pm) and a 10 dB addition to nocturnal (10:00 pm - 7:00 am) noise levels. The *Day/Night Average Sound Level (DNL or  $L_{dn}$ )* is essentially the same as CNEL, with the exception that the evening time period is dropped and all occurrences during this three-hour period are grouped into the daytime period.

## **Fundamentals of Groundborne Vibration**

Ground vibration consists of rapidly fluctuating motions or waves with an average motion of zero. Several different methods are typically used to quantify vibration amplitude. One method is the Peak Particle Velocity (PPV). The PPV is defined as the maximum instantaneous positive or negative peak of the vibration wave. In this report, a PPV descriptor with units of mm/sec or in/sec is used to evaluate construction generated vibration for building damage and human complaints. Table 3 displays the reactions of people and the effects on buildings that continuous vibration levels produce.

The annoyance levels shown in Table 3 should be interpreted with care since vibration may be found to be annoying at much lower levels than those shown, depending on the level of activity or the sensitivity of the individual. To sensitive individuals, vibrations approaching the threshold of perception can be annoying. Low-level vibrations frequently cause irritating secondary vibration, such as a slight rattling of windows, doors, or stacked dishes. The rattling sound can give rise to exaggerated vibration complaints, even though there is very little risk of actual structural damage.

Construction activities can cause vibration that varies in intensity depending on several factors. The use of pile driving and vibratory compaction equipment typically generates the highest construction related groundborne vibration levels. Because of the impulsive nature of such activities, the use of the PPV descriptor has been routinely used to measure and assess groundborne vibration and almost exclusively to assess the potential of vibration to induce structural damage and the degree of annoyance for humans.

The two primary concerns with construction-induced vibration, the potential to damage a structure and the potential to interfere with the enjoyment of life, are evaluated against different vibration limits. Studies have shown that the threshold of perception for average persons is in the range of 0.008 to 0.012 in/sec PPV. Human perception to vibration varies with the individual and is a function of physical setting and the type of vibration. Persons exposed to elevated ambient vibration levels, such as people in an urban environment, may tolerate a higher vibration level.

Structural damage can be classified as cosmetic only, such as minor cracking of building elements, or may threaten the integrity of the building. Safe vibration limits that can be applied to assess the potential for damaging a structure vary by researcher and there is no general consensus as to what amount of vibration may pose a threat for structural damage to the building. Construction-induced vibration that can be detrimental to the building is very rare and has only been observed in instances where the structure is at a high state of disrepair and the construction activity occurs immediately adjacent to the structure.

**TABLE 1 Definition of Acoustical Terms Used in this Report**

<b>Term</b>	<b>Definition</b>
Decibel, dB	A unit describing, the amplitude of sound, equal to 20 times the logarithm to the base 10 of the ratio of the pressure of the sound measured to the reference pressure. The reference pressure for air is 20 micro Pascals.
Sound Pressure Level	Sound pressure is the sound force per unit area, usually expressed in micro Pascals (or 20 micro Newtons per square meter), where 1 Pascal is the pressure resulting from a force of 1 Newton exerted over an area of 1 square meter. The sound pressure level is expressed in decibels as 20 times the logarithm to the base 10 of the ratio between the pressures exerted by the sound to a reference sound pressure (e. g., 20 micro Pascals). Sound pressure level is the quantity that is directly measured by a sound level meter.
Frequency, Hz	The number of complete pressure fluctuations per second above and below atmospheric pressure. Normal human hearing is between 20 Hz and 20,000 Hz. Infrasonic sound are below 20 Hz and Ultrasonic sounds are above 20,000 Hz.
A-Weighted Sound Level, dBA	The sound pressure level in decibels as measured on a sound level meter using the A-weighting filter network. The A-weighting filter de-emphasizes the very low and very high frequency components of the sound in a manner similar to the frequency response of the human ear and correlates well with subjective reactions to noise.
Equivalent Noise Level, $L_{eq}$	The average A-weighted noise level during the measurement period.
$L_{max}$ , $L_{min}$	The maximum and minimum A-weighted noise level during the measurement period.
$L_{01}$ , $L_{10}$ , $L_{50}$ , $L_{90}$	The A-weighted noise levels that are exceeded 1%, 10%, 50%, and 90% of the time during the measurement period.
Day/Night Noise Level, $L_{dn}$ or DNL	The average A-weighted noise level during a 24-hour day, obtained after addition of 10 decibels to levels measured in the night between 10:00 pm and 7:00 am.
Community Noise Equivalent Level, CNEL	The average A-weighted noise level during a 24-hour day, obtained after addition of 5 decibels in the evening from 7:00 pm to 10:00 pm and after addition of 10 decibels to sound levels measured in the night between 10:00 pm and 7:00 am.
Ambient Noise Level	The composite of noise from all sources near and far. The normal or existing level of environmental noise at a given location.
Intrusive	That noise which intrudes over and above the existing ambient noise at a given location. The relative intrusiveness of a sound depends upon its amplitude, duration, frequency, and time of occurrence and tonal or informational content as well as the prevailing ambient noise level.

Source: Handbook of Acoustical Measurements and Noise Control, Harris, 1998.

**TABLE 2 Typical Noise Levels in the Environment**

Common Outdoor Activities	Noise Level (dBA)	Common Indoor Activities
Jet fly-over at 1,000 feet	110 dBA	Rock band
Gas lawn mower at 3 feet	100 dBA	
Diesel truck at 50 feet at 50 mph	90 dBA	Food blender at 3 feet
Noisy urban area, daytime	80 dBA	Garbage disposal at 3 feet
Gas lawn mower, 100 feet Commercial area	70 dBA	Vacuum cleaner at 10 feet Normal speech at 3 feet
Heavy traffic at 300 feet	60 dBA	Large business office
Quiet urban daytime	50 dBA	Dishwasher in next room
Quiet urban nighttime Quiet suburban nighttime	40 dBA	Theater, large conference room
Quiet rural nighttime	30 dBA	Library Bedroom at night, concert hall (background)
	20 dBA	Broadcast/recording studio
	10 dBA	
	0 dBA	

Source: Technical Noise Supplement (TeNS), California Department of Transportation, September 2013.



**TABLE 3 Reaction of People and Damage to Buildings from Continuous or Frequent Intermittent Vibration Levels**

Velocity Level, PPV (in/sec)	Human Reaction	Effect on Buildings
0.01	Barely perceptible	No effect
0.04	Distinctly perceptible	Vibration unlikely to cause damage of any type to any structure
0.08	Distinctly perceptible to strongly perceptible	Recommended upper level of the vibration to which ruins and ancient monuments should be subjected
0.1	Strongly perceptible	Virtually no risk of damage to normal buildings
0.3	Strongly perceptible to severe	Threshold at which there is a risk of damage to older residential dwellings such as plastered walls or ceilings
0.5	Severe - Vibrations considered unpleasant	Threshold at which there is a risk of damage to newer residential structures

Source: Transportation and Construction Vibration Guidance Manual, California Department of Transportation, September 2013.

### **Regulatory Background – Noise**

The State of California and the City of San José have established regulatory criteria that are applicable in this assessment. The State CEQA Guidelines, Appendix G, are used to assess the potential significance of impacts pursuant to local General Plan policies, Municipal Code standards, or the applicable standards of other agencies. A summary of the applicable regulatory criteria is provided below.

**State CEQA Guidelines.** The CEQA contains guidelines to evaluate the significance of effects of environmental noise attributable to a proposed project. Under CEQA, noise impacts would be considered significant if the project would result in:

- (a) Exposure of persons to or generation of noise levels in excess of standards established in the local general plan or noise ordinance, or applicable standards of other agencies;
- (b) Exposure of persons to or generation of excessive groundborne vibration or groundborne noise levels;
- (c) A substantial permanent increase in ambient noise levels in the project vicinity above levels existing without the project;
- (d) A substantial temporary or periodic increase in ambient noise levels in the project vicinity above levels existing without the project;
- (e) For a project located within an airport land use plan or where such a plan has not been adopted within two miles of a public airport or public use airport, if the

project would expose people residing or working in the project area to excessive noise levels;

- (f) For a project within the vicinity of a private airstrip, if the project would expose people residing or working in the project area to excessive noise levels.

Pursuant to recent court decisions, the impacts of site constraints such as exposure of the proposed project to excessive levels of noise and vibration are not included in the Impacts and Mitigation Section of this report. Checklist items (a), (b), (e) and (f) are discussed with respect to the compatibility of the project with noise and vibration levels at the site in a separate section addressing Noise and Land Use Compatibility for consistency with the policies set forth in the City's General Plan. Checklist items (a) through (d) are applicable in the assessment of potential impacts resulting from the proposed project at off-site receptors.

CEQA does not define what noise level increase would be considered substantial. Typically, an increase in the DNL noise level resulting from the project at noise sensitive land uses of 3 dBA or greater would be considered a significant impact when projected noise levels would exceed those considered acceptable for the affected land use. An increase of 5 dBA DNL or greater would be considered a significant impact when projected noise levels would remain within those considered acceptable for the affected land use.

**2013 California Building Cal Green Code.** The State of California established exterior sound transmission control standards for new non-residential buildings as set forth in the 2013 California Green Building Standards Code (Section 5.507.4.1 and 5.507.4.2). The sections that pertain to this project are as follows:

**5.507.4.1 Exterior noise transmission, prescriptive method.** Wall and roof-ceiling assemblies exposed to the noise source making up the building envelope shall meet a composite STC rating of at least 50 or a composite OITC rating of no less than 40, with exterior windows of a minimum STC of 40 or OITC of 30 when the building falls within the 65 dBA  $L_{dn}$  noise contour of a freeway or expressway, railroad, industrial source or fixed-guideway noise source, as determined by the local general plan noise element.

**5.507.4.2 Performance method.** For buildings located, as defined by Section 5.507.4.1, wall and roof-ceiling assemblies exposed to the noise source making up the building envelope shall be constructed to provide an interior noise environment attributable to exterior sources that does not exceed an hourly equivalent noise level ( $L_{eq (1-hr)}$ ) of 50 dBA in occupied areas during any hour of operation.

**Santa Clara County Airport Land Use Commission Comprehensive Land Use Plan.** The Comprehensive Land Use Plan adopted by the Santa Clara County Airport land Use Commission contains standards for projects within the vicinity of San José International Airport which are relevant to this project:

#### 4.3.2.1 Noise Compatibility Policies

**Policy N-3** Noise impacts shall be evaluated according to the Aircraft Noise Contours presented on Figure 5 (2022 Aircraft Noise Contours).

***City of San José General Plan.*** The Environmental Leadership Chapter in the Envision San José 2040 General Plan sets forth policies with the goal of minimizing the impact of noise on people through noise reduction and suppression techniques, and through appropriate land use policies in the City of San José. The following policies are applicable to the proposed project:

**EC-1.1** Locate new development in areas where noise levels are appropriate for the proposed uses. Consider federal, state, and City noise standards and guidelines as a part of new development review. Applicable standards and guidelines for land uses in San José include:

#### Interior Noise Levels

- The City's standard for interior noise levels in residences, hotels, motels, residential care facilities, and hospitals is 45 dBA DNL. Include appropriate site and building design, building construction and noise attenuation techniques in new development to meet this standard. For sites with exterior noise levels of 60 dBA DNL or more, an acoustical analysis following protocols in the City-adopted California Building Code is required to demonstrate that development projects can meet this standard. The acoustical analysis shall base required noise attenuation techniques on expected Envision General Plan traffic volumes to ensure land use compatibility and General Plan consistency over the life of this plan.

#### Exterior Noise Levels

- The City does not have an acceptable exterior noise level objective for industrial land uses. Therefore, the City's standard for acceptable exterior noise level objective for office buildings, business commercial uses, and professional offices of 70 dBA DNL (General Plan Table EC-1) is used.

**Table EC-1: Land Use Compatibility Guidelines for Community Noise in San José**

LAND USE CATEGORY	EXTERIOR NOISE EXPOSURE (DNL IN DECIBELS (DBA))					
	55	60	65	70	75	80
1. Residential, Hotels and Motels, Hospitals and Residential Care <sup>1</sup>						
2. Outdoor Sports and Recreation, Neighborhood Parks and Playgrounds						
3. Schools, Libraries, Museums, Meeting Halls, Churches						
4. Office Buildings, Business Commercial, and Professional Offices						
5. Sports Arena, Outdoor Spectator Sports						
6. Public and Quasi-Public Auditoriums, Concert Halls, Amphitheaters						

<sup>1</sup>Noise mitigation to reduce interior noise levels pursuant to Policy EC-1.1 is required.

**Normally Acceptable:**

- Specified land use is satisfactory, based upon the assumption that any buildings involved are of normal conventional construction, without any special noise insulation requirements.

**Conditionally Acceptable:**

- Specified land use may be permitted only after detailed analysis of the noise reduction requirements and needed noise insulation features included in the design.

**Unacceptable:**

- New construction or development should generally not be undertaken because mitigation is usually not feasible to comply with noise element policies.

**EC-1.2** Minimize the noise impacts of new development on land uses sensitive to increased noise levels (Categories 1, 2, 3 and 6) by limiting noise generation and by requiring use of noise attenuation measures such as acoustical enclosures and sound barriers, where feasible. The City considers significant noise impacts to occur if a project would:

- Cause the DNL at noise sensitive receptors to increase by five dBA DNL or more where the noise levels would remain “Normally Acceptable;” or
- Cause the DNL at noise sensitive receptors to increase by three dBA DNL or more where noise levels would equal or exceed the “Normally Acceptable” level.

**EC-1.3** Mitigate noise generation of new nonresidential land uses to 55 dBA DNL at the property line when located adjacent to existing or planned noise-sensitive residential and public/quasi-public land uses.

**EC-1.6** Regulate the effects of operational noise from existing and new industrial and commercial development on adjacent uses through noise standards in the City’s Municipal Code.

**EC-1.7** Require construction operations within San José to use best available noise suppression devices and techniques and limit construction hours near residential uses per the City’s Municipal Code. The City considers significant construction noise impacts to occur if a project located within 500 feet of residential uses or 200 feet of commercial or office uses would:

- Involve substantial noise generating activities (such as building demolition, grading, excavation, pile driving, use of impact equipment, or building framing) continuing for more than 12 months.

For such large or complex projects, a construction noise logistics plan that specifies hours of construction, noise and vibration minimization measures, posting or notification of construction schedules, and designation of a noise disturbance coordinator who would respond to neighborhood complaints will be required to be in place prior to the start of construction and implemented during construction to reduce noise impacts on neighboring residents and other uses.

***City of San José Municipal Code.*** The City’s Municipal Code contains a Zoning Ordinance that limits noise levels at adjacent properties. Chapter 20.30.700 states that sound pressure levels generated by any use or combination of uses on a property shall not exceed 55 dBA at any property line shared with land zoned for residential use, except upon issuance and in compliance with a Conditional Use Permit. Chapter 20.50.300 states the sound pressure level generated by any use or combination of uses shall not exceed 70 dBA at any property line shared with land zoned for industrial use, except upon issuance and in compliance with a Conditional Use Permit.

Chapter 20.100.450 of the Municipal Code establishes allowable hours of construction within 500 feet of a residential unit between 7:00 am and 7:00 pm Monday through Friday unless permission is granted with a development permit or other planning approval. No construction activities are permitted on the weekends at sites within 500 feet of a residence.

### **Regulatory Background – Vibration**

***City of San José General Plan.*** The Environmental Leadership Chapter in the Envision San José 2040 General Plan sets forth policies to achieve the goal of minimizing vibration impacts on people, residences, and business operations in the City of San José. The following policies are applicable to the proposed project:

**EC-2.3** Require new development to minimize vibration impacts to adjacent uses during demolition and construction. For sensitive historic structures, a vibration limit of 0.08 in/sec PPV (peak particle velocity) will be used to minimize the potential for cosmetic damage to a building. A vibration limit of 0.20 in/sec PPV will be used to minimize the potential for cosmetic damage at buildings of normal conventional construction.

## Existing Noise Environment

The 9.9 acre project site is located at 2905 South King Road in the City of San José. Figure 1 shows the project site plan overlaid on an aerial image of the site vicinity. As shown on Figure 1, the project site is near existing residential and commercial/industrial land uses. There are adjacent residences located approximately five feet north and west of the project site, as well as residences approximately 105 feet east of the site opposite South King Road. The adjacent commercial/industrial buildings are located approximately five feet south of the project site. The project site is located approximately 1,275 feet northeast of the centerline of U.S. 101 and approximately 1.1 miles (5,700 feet) south of the Reid-Hillview Airport.

A noise monitoring survey was performed beginning on Tuesday, October 4, 2016 and concluding on Thursday, October 6, 2016. The monitoring survey included one long-term noise measurement (LT-1) and two short-term noise measurements (ST-1 and ST-2). All measurement locations are shown in Figure 1 and the daily trends in noise levels for the long-term measurement are shown in Figure 2. The noise environment at the site and at the nearby land uses results primarily from vehicular traffic along South King Road. Secondary traffic noise sources include vehicles along U.S. 101. Aircraft associated with Reid-Hillview Airport also affect the noise environment at the project site and in surrounding areas.

Long-term noise measurement LT-1 was made at a location along the east side of the project site, approximately 110 feet southwest from the centerline of South King Road. Hourly average noise levels at this location typically ranged from 61 to 68 dBA  $L_{eq}$  during the day and from 50 to 63 dBA  $L_{eq}$  at night. The day-night average noise level on Wednesday, October 5, 2016 was 66 dBA DNL. The daily trend in noise levels at LT-1 is shown in Figure 2.

Short-term noise measurement ST-1 was made in front of 2859 Barrow Court near residential land uses north of the project site. The 10-minute average noise level measured at this location between 1:20 p.m. and 1:30 p.m. on Tuesday, October 4, 2016 was 55 dBA  $L_{eq}$ . Short-term noise measurement ST-2 was made in front of 2928 Towers Lane near residences located southwest of the site. The 10-minute average noise level measured at this location between 1:40 p.m. and 1:50 p.m. on Tuesday, October 4, 2016 was 55 dBA  $L_{eq}$ . Table 4 summarizes the results of the short-term measurements.

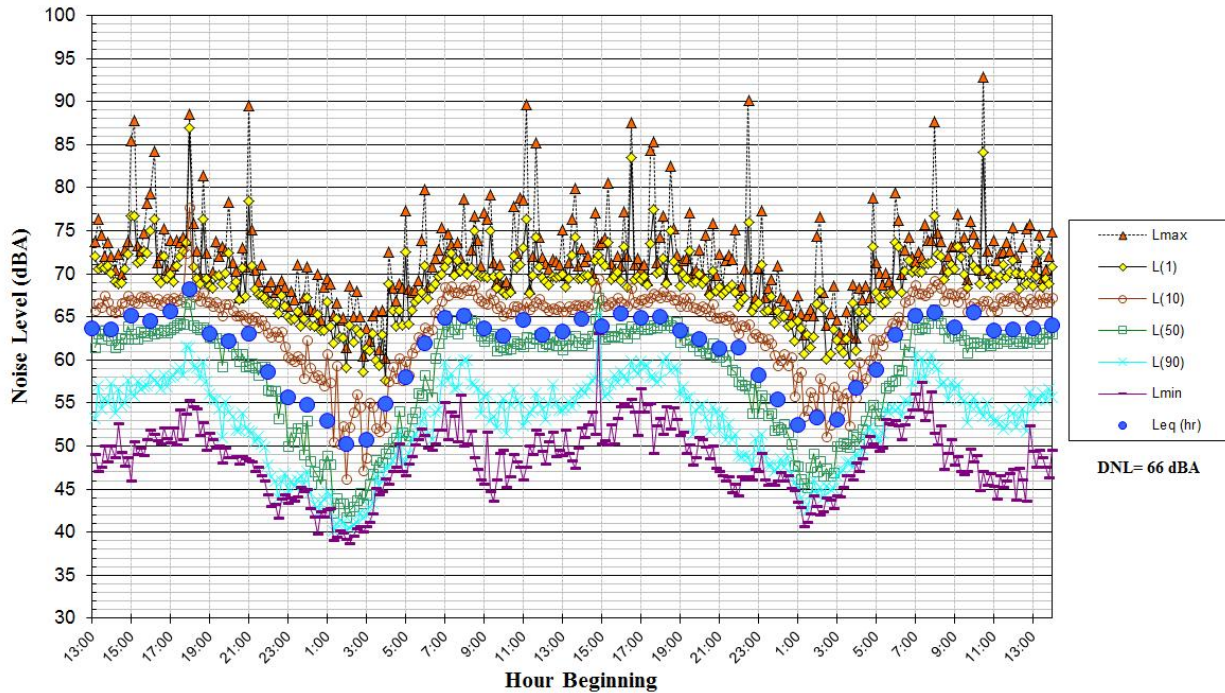


**FIGURE 1 Bay Area Self Storage-King Road Noise Measurement Locations**



Source: Google Earth

**FIGURE 2 Long Term Noise Level Daily Trends**  
**Noise Levels at Noise Measurement Site LT-1**  
**Tree on Site, 110 Feet Southwest from Centerline of South King Road**  
**Tuesday, October 4, 2016 through Thursday, October 6, 2016**



**TABLE 4 Summary of Short-Term Noise Measurement Data**

Noise Measurement Location	L <sub>max</sub>	L <sub>(1)</sub>	L <sub>(10)</sub>	L <sub>(50)</sub>	L <sub>(90)</sub>	L <sub>eq</sub>
ST-1: In front of 2859 Barrow Court. (10/4/2016, 1:20 p.m. – 1:30 p.m.)	74	67	54	46	43	55
ST-2: In front of 2928 Towers Lane. (10/4/2016, 1:40 p.m. – 1:50 p.m.)	70	67	59	47	44	55

**GENERAL PLAN CONSISTENCY ANALYSIS –  
COMPATIBILITY OF PROJECT WITH NOISE AND VIBRATION AFFECTING THE  
SITE**

**Noise and Land Use Compatibility**

The Environmental Leadership Chapter in the Envision San José 2040 General Plan sets forth policies with the goal of minimizing the impact of noise on people through noise reduction and suppression techniques, and through appropriate land use policies in the City of San José. The applicable General Plan policies were presented in detail in the Regulatory Background section and are summarized below for the proposed project:

- The City does not have an acceptable exterior noise level objective for industrial land uses. In the absence of an exterior noise standard for industrial land uses, the City’s acceptable exterior noise standard of 70 dBA DNL (General Plan Table EC-1) for office buildings, business commercial uses, and professional offices is used in this analysis to conservatively evaluate the noise and land use compatibility of the project.
- The City’s standard for interior noise at the proposed Manager’s Building is 45 dBA DNL.
- The California Green Building Code limits interior noise levels within new non-residential land uses to an hourly equivalent noise level (L<sub>eq (1-hr)</sub>) of 50 dBA in occupied areas during any hour of operation.

*Future Exterior Noise Environment*

The future noise environment at the project site would continue to result primarily from vehicular traffic along South King Road, with secondary vehicular traffic noise resulting from U.S. 101. The Envision San José 2040 General Plan EIR<sup>1</sup> estimated future noise level increases in the project vicinity. From these data, traffic noise along South King Road and U.S. 101 would increase by up to 1 dBA DNL by the year 2035. Therefore, future noise exposures at the facades of the buildings proposed at the site are calculated to reach up to 67 dBA DNL.

As noted above, the City’s acceptable exterior noise level standard is 70 dBA DNL or less for office buildings, business commercial uses, and professional offices. This standard is used in this

<sup>1</sup> Environmental Impact Report for the Envision San José 2040 General Plan, City of San José, June 2011.



analysis to conservatively evaluate the noise and land use compatibility of the project. The future exterior noise exposure at the site would be considered compatible with the proposed industrial land uses as noise levels are calculated to reach 67 dBA DNL, and would not exceed the 70 dBA DNL threshold.

#### *Future Interior Noise Environment*

The City's standard for interior noise at the proposed Manager's Building is 45 dBA DNL. In addition, the California Green Building Code requires that non-residential buildings shall be constructed to provide an interior noise environment that does not exceed an hourly equivalent noise level ( $L_{eq(1-hr)}$ ) of 50 dBA in occupied areas during any hour of operation. The self-storage buildings would not have sensitive receptors occupying the buildings the majority of the time, and would therefore not be subject to the interior noise standards. The light industrial buildings in the southeast portion of the site as well as the manager's office in the northeast corner would be subject to the interior noise thresholds. Assuming a 1 dBA increase in noise levels from South King Road and U.S. 101, the future exterior traffic noise exposure at all building facades would be at or below 67 dBA DNL.

Interior noise levels would vary depending upon the design of the buildings (relative window area to wall area) and the selected construction materials and methods. Standard residential construction provides approximately 15 dBA of exterior to interior noise reduction, assuming the windows are partially open for ventilation. Standard construction with the windows closed provides approximately 20 to 25 dBA of noise reduction in interior spaces. Where exterior noise levels range from 60 to 65 dBA DNL, the inclusion of adequate forced-air mechanical ventilation is often the method selected to reduce interior noise levels to acceptable levels by closing the windows to control noise. Where noise levels exceed 65 dBA DNL, forced-air mechanical ventilation systems and sound-rated construction methods are normally required. Such methods or materials may include a combination of smaller window and door sizes as a percentage of the total building façade facing the noise source, sound-rated windows and doors, sound-rated exterior wall assemblies, and mechanical ventilation so windows may be kept closed at the occupant's discretion.

For the proposed project, the interior noise level standards applicable to occupied interior spaces would be met assuming standard construction methods with the windows closed. In order to provide a habitable interior environment when doors and windows are closed for noise control purposes, a suitable form of forced-air mechanical ventilation, as determined by the local building official, should be provided for occupied interior spaces. No additional noise insulation features (e.g., sound-rated construction methods) would be required.

#### *Aircraft Noise*

Reid-Hillview Airport is located approximately 1.1 miles north of the project site. According to the 2022 Aircraft Noise Contour, the project site does not fall within the airport influence area and is located outside the 60 dBA CNEL noise contour. Noise levels produced by aircraft less than 65 dBA CNEL would be considered compatible with the proposed project.

## NOISE IMPACTS AND MITIGATION MEASURES

### Significance Criteria

Paraphrasing from Appendix G of the CEQA Guidelines, a project would normally result in significant noise impacts if noise levels generated by the project conflict with adopted environmental standards or plans, if the project would generate excessive groundborne vibration levels, or if ambient noise levels at sensitive receivers would be substantially increased over a permanent, temporary, or periodic basis. The following criteria were used to evaluate the significance of environmental noise resulting from the project:

- **Noise Levels in Excess of Standards:** A significant noise impact would be identified if the project would expose persons to or generate noise levels that would exceed applicable noise standards presented in the General Plan or Municipal Code.
- **Groundborne Vibration from Construction:** A significant impact would be identified if the construction of the project would expose persons to excessive vibration levels. Groundborne vibration levels exceeding 0.2 in/sec PPV would have the potential to result in cosmetic damage to normal buildings. Groundborne vibration levels exceeding 0.08 in/sec PPV would have the potential to result in cosmetic damage to sensitive historic structures.
- **Project-Generated Traffic Noise Increases:** A significant impact would be identified if traffic generated by the project would substantially increase noise levels at sensitive receivers in the vicinity. A substantial increase would occur if: a) the noise level increase is 5 dBA DNL or greater, with a future noise level of less than 60 dBA DNL, or b) the noise level increase is 3 dBA DNL or greater, with a future noise level of 60 dBA DNL or greater.
- **Construction Noise:** A significant noise impact would be identified if construction-related noise would temporarily increase ambient noise levels at sensitive receptors. Hourly average noise levels exceeding 60 dBA  $L_{eq}$  at the property lines shared with residential land uses, and the ambient by at least 5 dBA  $L_{eq}$ , for a period of more than one year would constitute a significant temporary noise increase at adjacent residential land uses. Hourly average noise levels exceeding 70 dBA  $L_{eq}$  at the property lines shared with commercial land uses, and the ambient by at least 5 dBA  $L_{eq}$ , for a period of more than one year would also constitute a significant temporary noise.

**Impact 1:** **Noise Levels in Excess of Standards.** The proposed project could generate noise in excess of established standards at the nearby sensitive receptors. **This is a potentially significant impact.**

#### *Construction Noise*

Chapter 20.100.450 of the City's Municipal Code establishes allowable hours of construction within 500 feet of a residential unit between 7:00 am and 7:00 pm Monday through Friday unless

permission is granted with a development permit or other planning approval. No construction activities are permitted on the weekends at sites within 500 feet of a residence. This analysis assumes that construction activities will occur between 7:00 am and 7:00 pm Monday through Friday and not on weekends. Project construction will be consistent with the code limits and the impact is less-than-significant.

### *Operational Noise*

General Plan Policy EC-1.3 states, “Mitigate noise generation of new nonresidential land uses to 55 dBA DNL at the property line when located adjacent to existing or planned noise sensitive residential and public/quasi-public land uses.” Chapter 20.30.700 of the City’s Municipal Code states that sound pressure levels generated by any use or combination of uses on a property shall not exceed 55 dBA at any property line shared with land zoned for residential use, except upon issuance and in compliance with a Conditional Use Permit. Chapter 20.50.300 states the sound pressure level generated by any use or combination of uses shall not exceed 70 dBA at any property line shared with land zoned for industrial use, except upon issuance and in compliance with a Conditional Use Permit.

Noise levels associated with self-storage facilities are primarily related to intermittent vehicle circulation and human voices. Potentially noisy industrial or commercial uses such as manufacturing operations or contractor’s yards could be located at industrial buildings A-D. Typical noise sources would likely include truck movement, loading docks, outdoor mechanical equipment, operations (depending on the user), and parking lots.

Noise sources such as loading docks would be expected to generate noise levels of about 50 to 60 dBA  $L_{eq}$  at 150 feet depending on the number of trucks accessing the loading dock and frequency of other extraneous noise sources associated with receiving areas (e.g., forklifts, etc.).

Noise associated with the use of parking lots would include vehicular circulation, loud engines, car alarms, squealing tires, door slams, and human voices. The maximum sound ( $L_{max}$ ) of a passing car at 15 mph typically ranges from 43 dBA to 53 dBA at 150 feet. The noise generated during an engine start is similar. Door slams create lower noise levels. Hourly average noise level resulting from all of these noise-generating activities in a busy parking lot could range from 35 dBA to 45 dBA  $L_{eq}$  at a distance of 150 feet from the parking area.

Heating, ventilation, and cooling equipment could generate noise levels in the range of 50 dBA to 70 dBA  $L_{eq}$  at 150 feet depending on the number, type, and size of the proposed equipment. Trash compactors typically generate maximum noise levels of 40 to 50 dBA at 150 feet, depending on the power rating and enclosure characteristics.

The conceptual site plan shows that the nearest residential land uses located to the north, west, and southwest of the site would be shielded from intermittent noise produced by the self-storage operations by Buildings A, B, F, G, and H, which are proposed along the north, west, and southwest boundaries of the site. The conceptual project design also locates the primary noise-generating areas of the commercial/industrial uses (e.g., roll-up doors accessed from driveways on the interior of the site) away from residences in the areas. These primary noise-generating

areas of the commercial/industrial uses would be shielded from the nearest residences by the buildings themselves. Although, noise from intermittent activities associated with the self-storage facility and commercial/industrial land uses would at times be audible, the infrequent noise would not be expected to produce noise levels exceeding existing conditions or 55 dBA DNL. Noise levels exceeding City Municipal Code standards could occur at the nearest receivers north, west, and southwest of the project site, depending on the ultimate industrial uses proposed, if the noise generated by such uses are not regulated or adequately mitigated. This represents a potentially significant impact.

### **Mitigation Measures 1:**

The following mitigation measures shall be included in the project to reduce the impact to a less-than-significant level:

- Mechanical equipment and trash enclosures in commercial and industrial areas shall be located away from adjacent residential receivers or shielded with noise barriers.
- Loading dock hours of operation shall be limited to daytime and evening hours (7 a.m. to 10 p.m.).
- Parking lot cleaning activities in commercial and industrial areas shall be limited to daytime and evening hours (7 a.m. to 10 p.m.).

With the implementation of the above measures, the impact would be less-than-significant.

**Impact 2: Exposure to Excessive Groundborne Vibration due to Construction.** Construction-related vibration levels resulting from activities at the project site would exceed 0.2 in/sec PPV at the nearest residential and commercial/industrial land uses. **This is a potentially significant impact.**

The construction of the project may generate vibration when heavy equipment or impact tools (e.g. jackhammers, hoe rams) are used. Construction activities would include demolition, site preparation work, excavation and grading, foundation work, paving, and new building framing and finishing. This analysis assumes the proposed project would not require pile driving, which can cause excessive vibration.

According to Policy EC-2.3 of the City of San José General Plan, a vibration limit of 0.08 in/sec PPV shall be used to minimize the potential for cosmetic damage to sensitive historical structures, and a vibration limit of 0.20 in/sec PPV shall be used to minimize damage at buildings of normal conventional construction. With no known historical buildings in the vicinity of the project site, a significant impact would occur if nearby buildings were exposed to vibration levels in excess of 0.20 in/sec PPV.

Table 5 presents typical vibration levels that could be expected from construction equipment at a distance of 25 feet. Project construction activities, such as drilling, the use of jackhammers, rock drills and other high-power or vibratory tools, and rolling stock equipment (tracked vehicles,

compactors, etc.), may generate substantial vibration in the immediate vicinity. Jackhammers typically generate vibration levels of 0.035 in/sec PPV, and drilling typically generates vibration levels of 0.09 in/sec PPV at a distance of 25 feet. Vibration levels would vary depending on soil conditions, construction methods, and equipment used.

**TABLE 5 Vibration Source Levels for Construction Equipment**

Equipment		PPV at 25 ft. (in/sec)	Approximate L <sub>v</sub> at 25 ft. (VdB)
Pile Driver (Impact)	upper range	1.158	112
	typical	0.644	104
Pile Driver (Sonic)	upper range	0.734	105
	typical	0.170	93
Clam shovel drop		0.202	94
Hydromill (slurry wall)	in soil	0.008	66
	in rock	0.017	75
Vibratory Roller		0.210	94
Hoe Ram		0.089	87
Large bulldozer		0.089	87
Caisson drilling		0.089	87
Loaded trucks		0.076	86
Jackhammer		0.035	79
Small bulldozer		0.003	58

Source: Transit Noise and Vibration Impact Assessment, United States Department of Transportation, Office of Planning and Environment, Federal Transit Administration, May 2006.

The residential land uses closest to the project site include the adjacent residences five feet north and west of the project property line. At these distances, vibration levels at the adjacent residences produced by the equipment having the highest potential for high vibration levels (i.e., vibratory roller, impact tools, etc.) would be up to 1.2 in/sec PPV, which exceeds the 0.2 in/sec PPV threshold. The remaining residential land uses are 105 feet east of the project site across South King Road. At these distances, vibration levels would be at or below 0.04 in/sec PPV, which would be below the 0.2 in/sec PPV threshold. The closest commercial/industrial land uses are adjacent to the project site, approximately five feet to the south of the project property line. At these distances, vibration levels at the adjacent commercial/industrial buildings would be up to 1.2 in/sec PPV, which exceeds the 0.2 in/sec PPV threshold. This is a potentially significant impact.

Vibration levels may at times be perceptible and could cause annoyance. However, as with any type of construction, perceptible vibration would be anticipated and would not be considered significant, given the intermittent and short duration of the phases that have the highest potential of producing vibration (e.g., use of jackhammers and other high power tools). By use of administrative controls, such as notifying neighbors of scheduled construction activities and scheduling construction activities with the highest potential to produce perceptible vibration during hours with the least potential to affect nearby businesses, perceptible vibration can be kept to a minimum.

## **Mitigation Measures 2:**

The following measures are recommended to reduce vibration impacts from construction activities:

- Prohibit the use of heavy vibration-generating construction equipment, such as vibratory rollers or excavation using clam shell or chisel drops, within 20 feet of any adjacent building.
- Designate a person responsible for registering and investigating claims of excessive vibration. The contact information of such person shall be clearly posted on the construction site.

The implementation of these mitigation measures would reduce the impact to a less-than-significant level.

**Impact 3: Substantial Permanent Noise Increase due to Project-Generated Traffic.** Project-generated traffic would not cause a permanent noise level increase at existing noise-sensitive land uses in the project vicinity. **This is a less-than-significant impact.**

A significant noise impact would occur if traffic generated by the project would substantially increase noise levels at sensitive receptors in the project vicinity. A substantial increase would occur if: a) the noise level increase is 5 dBA DNL or greater, with a future noise level of less than 60 dBA DNL, or b) the noise level increase is 3 dBA DNL or greater, with a future noise level of 60 dBA DNL or greater. The nearest noise-sensitive receptors are approximately five feet to the north and west of the project site where the ambient noise levels are above 60 dBA DNL; therefore, a significant impact would occur if project-generated traffic would permanently increase noise levels by 3 dBA DNL. For reference, traffic volumes would have to double for noise levels to increase by 3 dBA DNL.

Traffic noise levels from South King Road dominate the noise environment in the area. The project's traffic information provided trip generation estimates for project traffic along South King Road. These trip generation estimates were reviewed to calculate the permanent noise increase attributable to project-generated traffic. The modeled traffic noise levels attributable to projects trips are calculated to be 45 dBA DNL along South King Road. As shown from LT-1, the day-night average noise level at receptors by the entrance on South King Road is 66 dBA DNL. The relatively low volume of additional traffic along roadways serving the site would not measurably increase the ambient noise environment on an hourly average or daily average basis. Therefore, future noise level generated by traffic will continue to be above 60 dBA DNL and the noise level increase attributable to the project will be less than 3 dBA DNL. This is a **less-than-significant**

**Mitigation Measures 3: None required.**

**Impact 4: Substantial Temporary Noise Increase due to Construction.** Existing noise-sensitive land uses would be exposed to construction noise levels in excess of the significance thresholds for a period of more than one year. **This is a potentially significant impact.**

Noise impacts resulting from construction depend upon the noise generated by various pieces of construction equipment, the timing and duration of noise-generating activities, and the distance between construction noise sources and noise-sensitive areas. Construction noise impacts primarily result when construction activities occur during noise-sensitive times of the day (e.g., early morning, evening, or nighttime hours), the construction occurs in areas immediately adjoining noise-sensitive land uses, or when construction lasts over extended periods of time.

Where noise from construction activities exceeds 60 dBA  $L_{eq}$  and exceeds the ambient noise environment by at least 5 dBA  $L_{eq}$  at noise-sensitive residential uses in the project vicinity for a period exceeding one year, the impact would be considered significant. For commercial uses, a significant impact would be identified if construction noise were to exceed 70 dBA  $L_{eq}$  and exceeds the ambient noise environment by at least 5 dBA  $L_{eq}$  for a period exceeding one year. Additionally, the City considers significant construction noise impacts to have occurred if a project located within 500 feet of residential uses or 200 feet of commercial or office uses would involve substantial noise-generating activities (such as building demolition, grading, excavation, pile driving, use of impact equipment, or building framing) continuing for more than 12 months, according to Policy EC-1.7 of the General Plan.

Construction activities for individual projects are typically carried out in stages. During each stage of construction, there would be a different mix of equipment operating, and noise levels would vary by stage and vary within stages, based on the amount of equipment in operation and the location at which the equipment is operating. Typical construction noise levels at a distance of 50 feet are shown in Tables 6 and 7. Table 6 shows the average noise level ranges, by construction phase, and Table 7 shows the maximum noise level ranges for different construction equipment. Most demolition and construction noise falls with the range of 80 to 90 dBA at a distance of 50 feet from the source.

**TABLE 6 Typical Ranges of Construction Noise Levels at 50 Feet,  $L_{eq}$  (dBA)**

	Domestic Housing		Office Building, Hotel, Hospital, School, Public Works		Industrial Parking Garage, Religious Amusement & Recreations, Store, Service Station		Public Works Roads & Highways, Sewers, and Trenches	
	I	II	I	II	I	II	I	II
	Ground Clearing	83	83	84	84	84	83	84
Excavation	88	75	89	79	89	71	88	78
Foundations	81	81	78	78	77	77	88	88
Erection	81	65	87	75	84	72	79	78
Finishing	88	72	89	75	89	74	84	84

I - All pertinent equipment present at site.  
 II - Minimum required equipment present at site.

Source: U.S.E.P.A., Legal Compilation on Noise, Vol. 1, p. 2-104, 1973.

**TABLE 7 Construction Equipment 50-foot Noise Emission Limits**

Equipment Category	$L_{max}$ Level (dBA) <sup>1,2</sup>	Impact/Continuous
Arc Welder	73	Continuous
Auger Drill Rig	85	Continuous
Backhoe	80	Continuous
Bar Bender	80	Continuous
Boring Jack Power Unit	80	Continuous
Chain Saw	85	Continuous
Compressor <sup>3</sup>	70	Continuous
Compressor (other)	80	Continuous
Concrete Mixer	85	Continuous
Concrete Pump	82	Continuous
Concrete Saw	90	Continuous
Concrete Vibrator	80	Continuous
Crane	85	Continuous
Dozer	85	Continuous
Excavator	85	Continuous
Front End Loader	80	Continuous
Generator	82	Continuous
Generator (25 KVA or less)	70	Continuous
Gradall	85	Continuous
Grader	85	Continuous
Grinder Saw	85	Continuous
Horizontal Boring Hydro Jack	80	Continuous
Hydra Break Ram	90	Impact
Impact Pile Driver	105	Impact
Insitu Soil Sampling Rig	84	Continuous
Jackhammer	85	Impact
Mounted Impact Hammer (hoe ram)	90	Impact



Equipment Category	L <sub>max</sub> Level (dBA) <sup>1,2</sup>	Impact/Continuous
Paver	85	Continuous
Pneumatic Tools	85	Continuous
Pumps	77	Continuous
Rock Drill	85	Continuous
Scraper	85	Continuous
Slurry Trenching Machine	82	Continuous
Soil Mix Drill Rig	80	Continuous
Street Sweeper	80	Continuous
Tractor	84	Continuous
Truck (dump, delivery)	84	Continuous
Vacuum Excavator Truck (vac-truck)	85	Continuous
Vibratory Compactor	80	Continuous
Vibratory Pile Driver	95	Continuous
All other equipment with engines larger than 5 HP	85	Continuous

Notes:

<sup>1</sup> Measured at 50 feet from the construction equipment, with a “slow” (1 sec.) time constant.

<sup>2</sup> Noise limits apply to total noise emitted from equipment and associated components operating at full power while engaged in its intended operation.

<sup>3</sup> Portable Air Compressor rated at 75 cfm or greater and that operates at greater than 50 psi.

Source: Mitigation of Nighttime Construction Noise, Vibrations and Other Nuisances, National Cooperative Highway Research Program, 1999.

Construction activities generate considerable amounts of noise, especially during earth-moving activities when heavy equipment is used. The construction of the proposed project would consist of demolishing existing buildings and structures, grading and excavating to lay foundations, building erection, and paving. The hauling of excavated materials and construction materials would generate truck trips on local roadways as well.

Nearby noise sensitive land uses include residences adjacent to the north and west of the project site, residences to the east across South King Road, and commercial/industrial buildings to the south. Hourly average noise levels due to construction activities during busy construction periods outdoors would range from about 74 to 86 dBA L<sub>eq</sub> at a distance of 50 feet. Construction-generated noise levels drop off at a rate of about 6 dBA per doubling of the distance between the source and receptor. The noise sensitive land uses (residences) are approximately five feet and 105 feet from the project site. At these distances, hourly average noise levels during busy construction periods would range from 94 to 106 dBA L<sub>eq</sub> for the adjacent residences and from 68 to 80 dBA L<sub>eq</sub> for the residences across South King Road. Construction noise levels would be expected to exceed 60 dBA L<sub>eq</sub> and exceed the ambient noise environment by at least 5 dBA L<sub>eq</sub> at noise-sensitive residential uses in the project vicinity for a period exceeding one year. Commercial/industrial land uses would be exposed to construction noise levels of 94 to 106 dBA L<sub>eq</sub> at a distance of five feet from the project site. Such noise levels would exceed 70 dBA L<sub>eq</sub> and the ambient noise environment by at least 5 dBA L<sub>eq</sub> for a period exceeding one year. Construction noise levels would be expected to exceed both the 60 dBA L<sub>eq</sub> residential and 70 dBA L<sub>eq</sub> commercial/industrial thresholds, as well as exceed the ambient noise environment by at least 5 dBA L<sub>eq</sub> at noise-sensitive uses in the project vicinity for a period exceeding one year. The impact would be considered potentially significant.

#### **Mitigation Measure 4:**

Policy EC-1.7 of the City's General Plan states that for large or complex projects within 500 feet of residential land uses or within 200 feet of commercial land uses or offices involving substantial noise-generating activities lasting more than 12 months, a construction noise logistics plan that specifies hours of construction, noise and vibration minimization measures, posting or notification of construction schedules, and designation of a noise disturbance coordinator who would respond to neighborhood complaints will be required to be in place prior to the start of construction and implemented during construction to reduce noise impacts on neighboring residents and other uses.

Modification, placement, and operation of construction equipment are possible means for minimizing the impact on the existing sensitive receptors. Construction equipment should be well-maintained and used judiciously to be as quiet as possible. Additionally, construction activities for the proposed project should include the following best management practices to reduce noise from construction activities near sensitive land uses:

- Construction activities shall be limited to the hours between 7:00 am and 7:00 pm, Monday through Friday, unless permission is granted with a development permit or other planning approval. No construction activities are permitted on the weekends at sites within 500 feet of a residence.
- Equip all internal combustion engine-driven equipment with intake and exhaust mufflers that are in good condition and appropriate for the equipment.
- Unnecessary idling of internal combustion engines should be strictly prohibited.
- Locate stationary noise-generating equipment such as air compressors or portable power generators as far as possible from sensitive receptors. Construct temporary noise barriers to screen stationary noise-generating equipment when located near adjoining sensitive land uses. Temporary noise barriers could reduce construction noise levels by 5 dBA.
- Utilize "quiet" air compressors and other stationary noise sources where technology exists.
- Control noise from construction workers' radios to a point where they are not audible at existing residences bordering the project site.
- Notify all adjacent business, residences, and other noise-sensitive land uses of the construction schedule, in writing, and provide a written schedule of "noisy" construction activities to the adjacent land uses and nearby residences.
- A temporary noise control blanket barrier could be erected, if necessary, along the property lines of the construction site between the site and adjacent buildings. This mitigation would only be necessary if conflicts occurred which were irresolvable by proper scheduling. Noise control blanket barriers can be rented and quickly erected.

- Designate a "disturbance coordinator" who would be responsible for responding to any complaints about construction noise. The disturbance coordinator will determine the cause of the noise complaint (e.g., bad muffler, etc.) and will require that reasonable measures be implemented to correct the problem. Conspicuously post a telephone number for the disturbance coordinator at the construction site and include in it the notice sent to neighbors regarding the construction schedule.

Implementation of the above measures would reduce construction noise levels emanating from the site, limit construction hours, and minimize disruption and annoyance. With the implementation of these measures, and recognizing that noise generated by construction activities would occur over a temporary period, the temporary increase in ambient noise levels would be **less-than-significant**.