
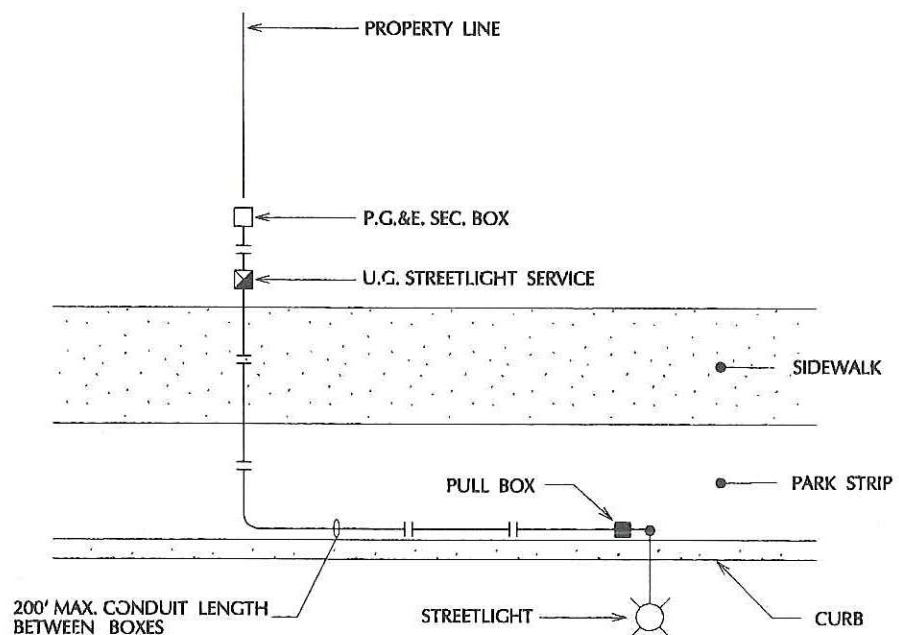



CONDUIT LENGTH 'L' TABLE	
IF 'L' IS LESS THAN 10' - THEN PULL BOX IS NOT REQUIRED AT ELECTROLIER	
IF 'L' IS GREATER THAN 10' - THEN PULL BOX IS REQUIRED AT ELECTROLIER. PLACE PULL BOX ADJACENT TO ELECTROLIER, PER "EXTENDED FOUNDATION CAP" DRAWING E-14	

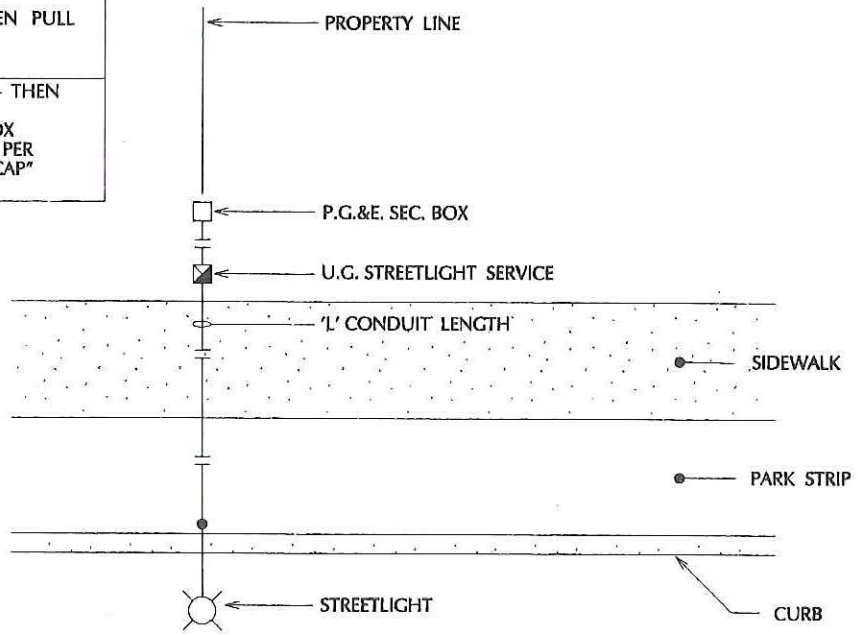

NOTE:
SEE DRAWINGS E-33, E-34, E-35, AND E-36 FOR UNDERGROUND SERVICE REQUIREMENTS.

APPROVED BY <i>Acid</i>	P.G.&E. SECONDARY /U.G. STREETLIGHT SERVICE PULL BOX LOCATION FOR NEW U.G. RESIDENTIAL DEVELOPMENT		DRAWING NO.
			E-32
DATE 3/3/92	DEPARTMENT OF PUBLIC WORKS		