


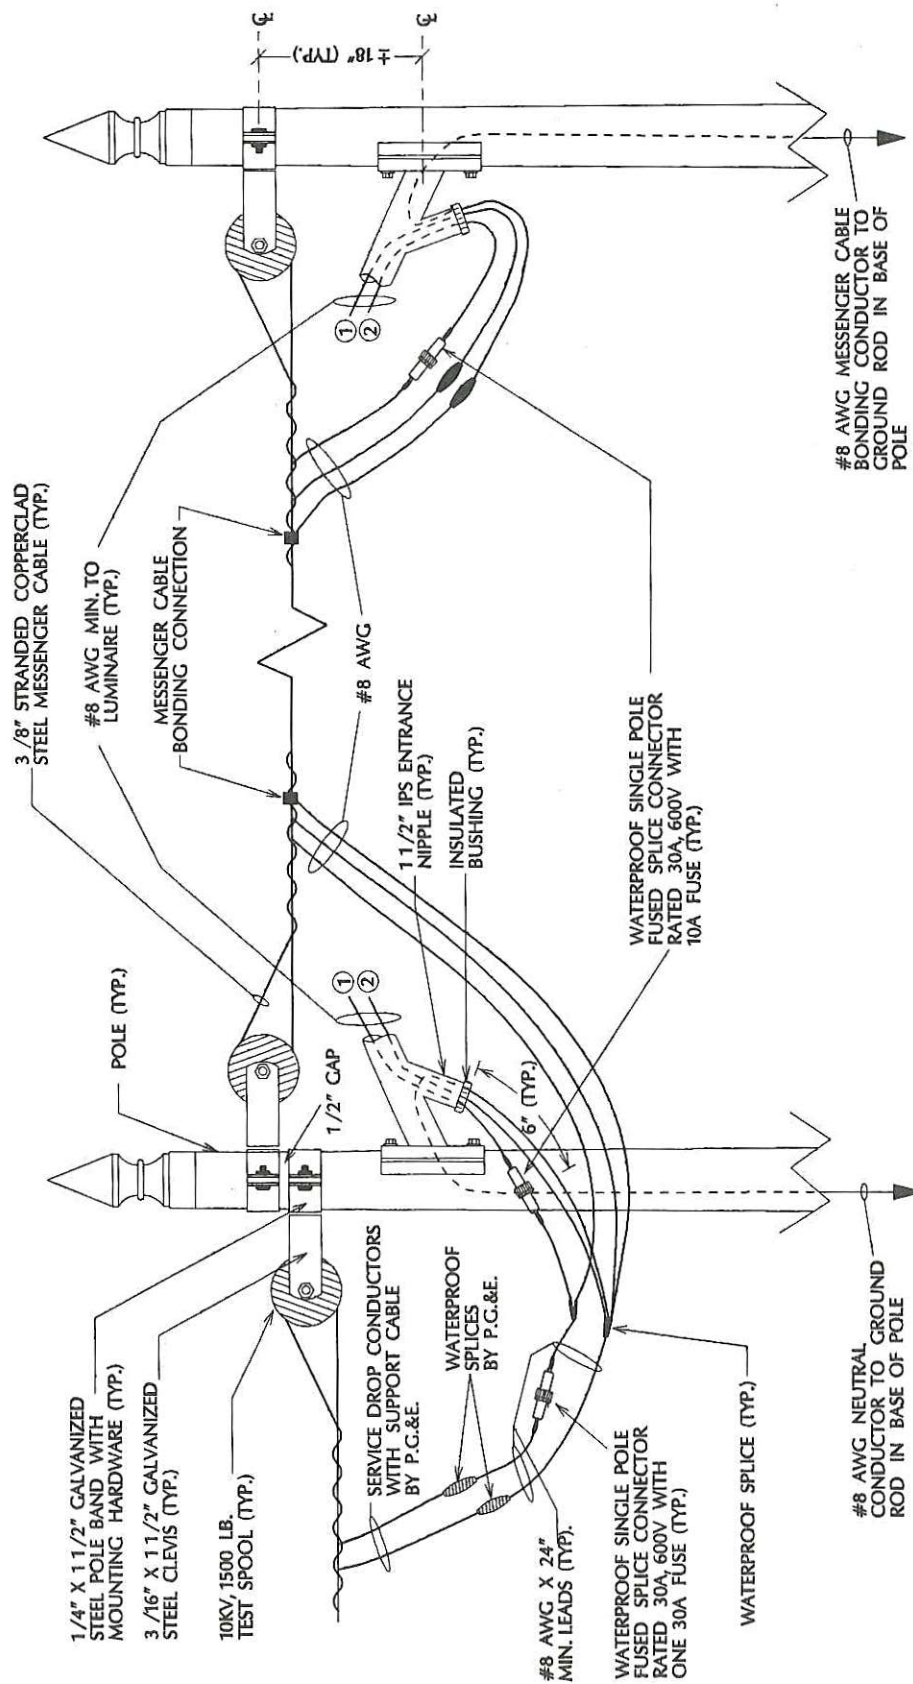

CONDUCTORS:
 ① UNGROUNDED
 ② NEUTRAL

NOTES:
 1. SEE DWGS. E-41 AND E-42 FOR POLE GROUNDING REQUIREMENTS.
 2. SEE DWG. E-45 FOR NOTES.
 3. GROUND THE MESSENGER AS REQUIRED BY NATIONAL ELECTRICAL CODE.

APPROVED BY


[Signature]

DATE

3/3/92

120V OVERHEAD MULTIPLE STREETLIGHT SERVICE TYPE - IIC

DEPARTMENT OF PUBLIC WORKS



DRAWING
 NO.

E-43