
- NOTES: 1. ANODE TO BE INSTALLED WITH EVERY SERVICE CONNECTION (STD. DETAIL W-1) ON STEEL MAIN NOT UNDER CATHODIC PROTECTION (SEE ENGINEER).
 - 2. LEAVE ENOUGH SLACK IN CABLE TO PREVENT DAMAGE DURING BACKFILL OPERATIONS.
 - 3. ANODE MAY BE INSTALLED HORIZONTALLY IF LOCATED BELOW THE SPRINGLINE OF THE PIPE.

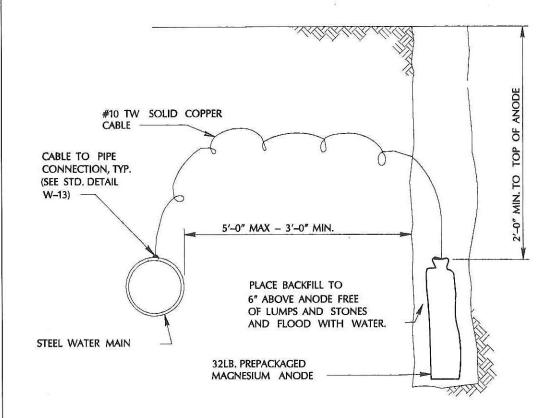

APPROVED BY

benest

MAGNESIUM ANODE INSTALLATION

DATE

4 - 1 - 2 - 2

DEPARTMENT OF PUBLIC WORKS



DRAWING NO.

W-14